

# Emergency Lighting Test Switch

**Standard and IP65 Rated**

**Product Code: BEL-ETS1**  
Standard Test Switch



**Product Code: BEL-ETS1WP**  
Weatherproof Test Switch (IP65)




The Australian Standards AS2293 specifies that a 2 Hour discharge test has to be performed to commission an emergency lighting installation and a 90-minute discharge test has to be performed at least 6 months thereafter.

It is also stated that a test switch has to be provided to permit the operation of each emergency escape luminaire or exit sign to be checked by simulating a supply circuit failure with the ability to come back on by itself should the person conducting the test fail to return and attend to the switch after a test is done.

Both the ETS1 and ETS1WP emergency lighting test switches provide a simple test procedure for the emergency lighting circuits connected to it to simulate a supply circuit failure.

At the conclusion of the two hour test period the contactor will automatically close and the emergency lighting circuits will be energised by the normal mains supply. The emergency lighting test can be cancelled at any time by turning the spring-loaded rotary switch to the reset position.

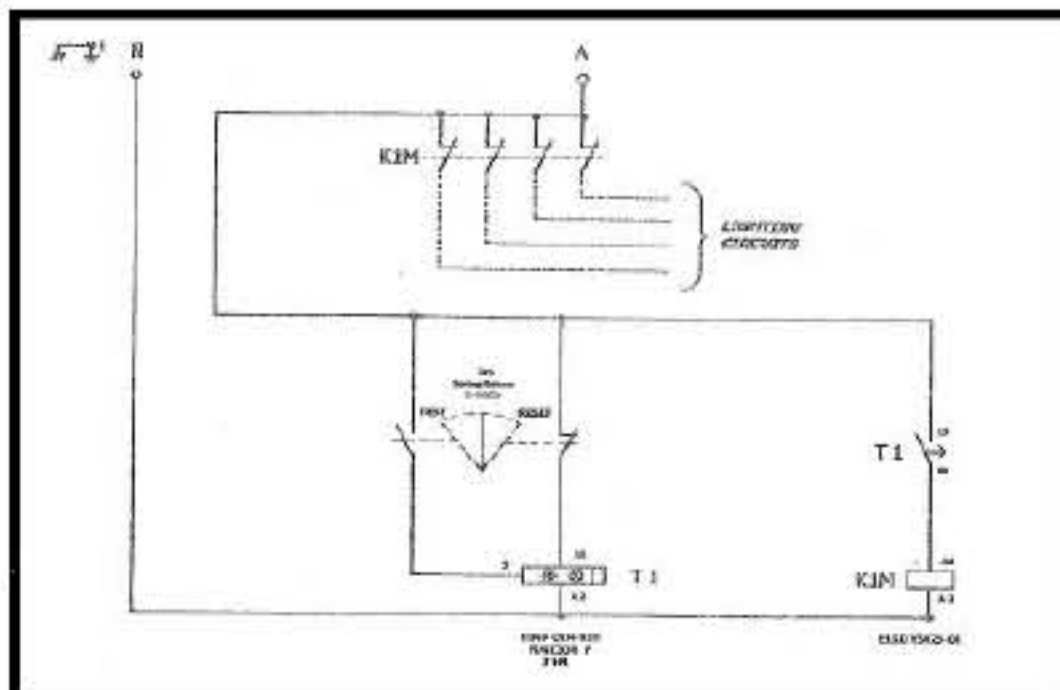

**M+H Power Systems Pty Ltd**  
A member of the MPower Group

**Head Office**  
9 Mosrael Place  
Rowville, VIC, 3178  
Tel: 03 9763 0555  
Fax: 03 9763 0577

**New South Wales**  
33 Shepherd Street  
Liverpool, NSW, 2170  
Tel: 02 9600 6555  
Fax: 02 9601 1317

**Queensland**  
Unit 2  
14 Hook Street  
Capalaba, QLD, 4157  
Tel: 07 3823 4933  
Fax: 073245 1327

**South Australia**  
Units 3, 4 & 5  
70-72 Pym Street  
Dudley Park, SA, 5008  
Tel: 08 8269 1674  
Fax: 08 8269 1671

**Western Australia**  
Unit 2  
10 Mordaunt Court  
Canning Vale, WA, 6155  
Tel: 08 6254 2211  
Fax: 08 6254 2299

**NEW ZEALAND**  
**NEW ZEALAND**  
**Auckland**  
Unit B  
237 Bush Road  
Albany, Auckland  
Tel: 0011 649 415 6615  
Fax: 0011 649 415 8160

**Wellington**  
Unit 7  
30-32 Downer Street  
Lower Hutt, Wellington  
Tel: 0011 644 586 6188  
Fax: 0011 644 586 6088

**Christchurch**  
Spark House  
5 Sydenham Street South  
Christchurch  
Tel: 0011 603 335 0639  
Fax: 0011 603 377 5274

